

EU DECLARATION OF CONFORMITY

No. 1A-EU-05/23-04

In accordance with EU directive 2014/35/EU as amended

We, **KOPOS KOLÍN a. s.**
Havlíčková 432
280 02 Kolín
Czech Republic
IČ: 61672971
DIČ: CZ61672971

declare under our sole responsibility that

the product/type: **Elektroinstallation boxes LK and accessories**

manufacturer: **KOPOS KOLÍN a.s. Havlíčkova 432, Kolín IV, 280 02 Kolín, Czech Republic**

object of the declaration: Wiring boxes for electric accessories for house and other similar fixed electrical installations.

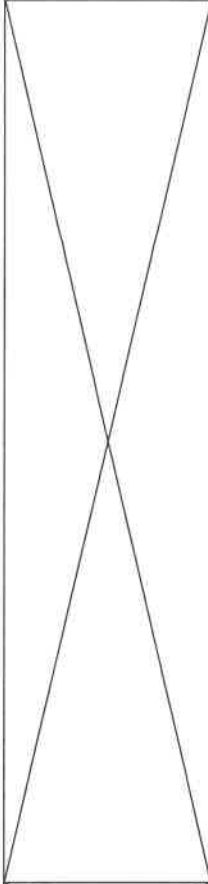
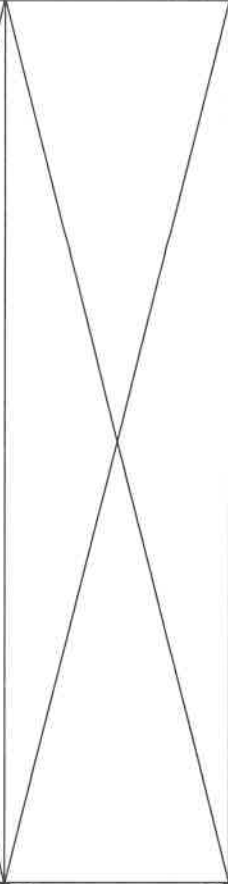
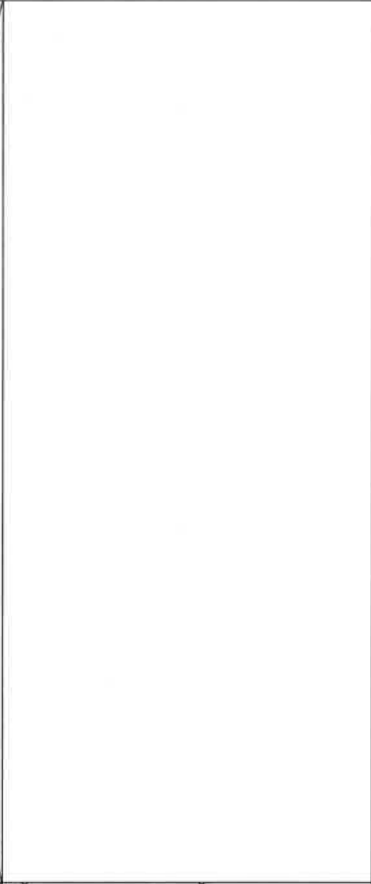
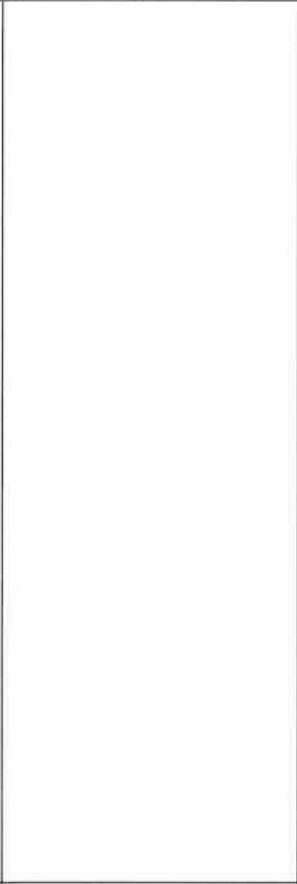









Boxes are resistant to flame propagation.

Temperature resistant of the boxes for installation is -5 ° C to + 60 ° C.

Color design according to customer requirements.

The object of the declaration described above is in conformity with the relevant Union harmonisation legislation, other legislation and regulations.

Regulations Of the European Union	Government Regulations	Standards	Certificates and Test Reports	Other technical specification/tested products
2014/35/EU - LVD	Law No. 90/2016 Coll. as amended Government Regulation No. 118/2016 Coll. as amended	ČSN EN IEC 60670-1 ed.2:21 including amendments ČSN EN 60670-1:05 +Z1:10+A1:13+Z2:21 including amendments (EN 60670-1:05 including amendments) ČSN EN 60670-22:07 including amendments (EN 60670-22:06 including amendments)	Test Report No. 230187-01/01 of 31.03.2023 Issued by: Electrotechnical Testing Institute, Pod Lisem 129, 171 02 Prague 71, Czech Republic	
2014/35/EU - LVD	Law No. 90/2016 Coll. as amended Government Regulation No. 118/2016 Coll. as amended	ČSN EN 60670-1:05+ Z1:10+A1:13 including amendments (EN 60670-1:05 including amendments)	Test Report No. 703535-01/01 of 25.9.2017 Issued by: Electrotechnical Testing Institute, Pod Lisem 129, 171 02 Prague 71, Czech Republic	
		ČSN EN 60529:1993+A1:2001+A2:2014 including amendments, (EN 60529:1993 including amendments) ČSN EN 60670-1:2005+Z1:2010+A1:2013, čl. 13.2 including amendments (EN 60670-1:2005 including amendments)	Test Report No. 700333-01/01 of 18.4.2017 Issued by: Electrotechnical Testing Institute, Pod Lisem 129, 171 02 Prague 71, Czech Republic	The test IP 40 was tested for the products: box LK 80x20R/1 box LK 80/3 box LK 80R/1 box LK 80R/2 box LK 80/1 box LK 80x16T box LK 80x28R/1 box LK 80/2 box LK 80R/3 box LK 80x28/1 box LK 80x28T Accessories: cover VLK 80 cover VLK 80/R

				cover VLK 80/T The above mentioned products meet IP 40 with the following accessories Products are made from PVC and are structurally identical boxes that contain the model numbers acronym HF (halogen free). Type: box LK 80x20R/1 HF box LK 80/3 HF box LK 80R/1 HF box LK 80R/2 HF box LK 80/1 HF box LK 80x16T HF box LK 80x28R/1 HF box LK 80/2 HF box LK 80R/3 HF box LK 80x28/1 HF box LK 80x28T HF Accessories: cover VLK 80 HF cover VLK 80/R HF cover VLK 80/T HF The above mentioned products meet IP 40 with the following accessories.				
						ČSN EN 60670-1, ČSN EN IEC 60670-1 ed. 2	Internal test Report No. 009/2022 of 9.5.2022	LK 80x28 T
								Halogen-free (HF) according to documents from the supplier
				Regulation 1907/2006 - REACH				Safety data sheets for used materials

By fulfilling the conditions in accordance with these regulations was placed on the product CE marking.

Conformity assessment module: **MODUL A: Internal production control**

Technical documentation of products:

- assembly instructions
- Datasheet
- Catalog for products freely available on <http://www.kopos.en/com/catalogy>
- Internal documents


KOPOS KOLÍN a.s. company is certificated according to the standard ISO 9001:2015, ISO 14001:2015 and ISO 50001:2018 and according to the National program „Safety Enterprise“.

Signed on behalf of KOPOS KOLÍN a.s.

Place of issue: Kolín, Czech Republic

Date of issue: 14.04.2023

Ing. Jana Dejmková
quality director

Jana Dejmková
 KOPOS KOLÍN a.s. 
 Havlíčkova 432, 280 02 Kolín
 IČ: 616 72 971 DIČ: CZ61672971
 tel: 321 730 111 www.kopos.cz

Enclosure No. 1 to EU Conformity Declaration No. 1A-EU-05/23-04
Elektroinstalation boxes LK and accessories

Name	Type	For trunkings
instrument box	LK 80/1	LK 80/1 HF
	LK 80/2	LK 80/2 HF
	LK 80/3	LK 80/3 HF
	LK 80R/1	LK 80R/1 HF
	LK 80R/2	LK 80R/2 HF
	LK 80R/3	LK 80R/3 HF
	LK 80x16 T	LK 80x16 T HF
	LK 80x20R/1	LK 80x20R/1 HF
	LK 80x28 2R	LK 80x28 2R HF
	LK 80x28 2T	LK 80x28 2T HF
	LK 80x28 2ZK	LK 80x28 2ZK HF
	LK 80x28 2ZT	LK 80x28 2ZT HF
	LK 80x28 T	LK 80x28 T HF
	LK 80x28/1	LK 80x28/1 HF
	LK 80x28R/1	LK 80x28R/1 HF
	LKM 45	LKM 45 HF
	cover	VLK 80
VLK 80/T		VLK 80/T HF
VLK 80/R		VLK 80/R HF
VLK 80/2R		VLK 80/2R HF
VLK 120		VLK 120 HF

Accessories for instrument box

extension frame	NR 2ZT	NR 2ZT HF
	NR 80 R, NR 80/R	NR 80 R HF, NR 80/R HF
	NRT	NRT HF
	NR 2 ZPK	NR 2 ZPK HF
pad insulating	PI 80 2ZT	
	PI 80 2ZK	
	PI 80 R	
	PI 80 T	
Terminal block	S-66	
Screwless terminals	TYP015-TYP018	

M. J. K.
KOPOS KOLÍN a.s. 
Havlíčková 432, 280 02 Kolín
IČ: 616 72 971 DIČ: CZ61672971
tel: 321 730 111 www.kopos.cz

